

SMYRNA *High School*



Certificate of Necessity



Gipe Associates, Inc.
CONSULTING ENGINEERS

Mechanical / Electrical Engineer
8719 Brooks Drive
Easton, MD 21601
410.822.8688

Project No.: 18047
August 09, 2019

SMYRNA
School District

CONTENTS

1 Executive Summary.....	2
1.1 Property Information and General MEP systems Condition.....	2
1.2 Anticipated Lifecycle Replacement.....	2
1.3 Cost Estimates.....	2
2 Scope and Methodology	3
2.1 Scope.....	3
2.2 Methodology.....	3
2.3 Condition Assessment Priority Definitions	3
3 Mechanical and Plumbing Systems.....	4
3.1 Heating, Ventilating and Air Conditioning (HVAC).....	4
3.2 Domestic Water Plumbing Systems	14
4 Electrical Systems.....	16
4.1 Electrical Service	16
4.2 Emergency Power	16
4.3 Lighting Systems.....	17
4.4 Power	17
4.5 Special Systems	18
4.6 Fire Alarm System	18
4.7 Code Deficiencies.....	19
Appendix A – Facility Photographs	
Appendix B – Cost Estimates	

1 EXECUTIVE SUMMARY

1.1 Property Information and General MEP systems Condition

Smyrna High School is located at 500 Duck Creek Parkway, Smyrna, DE. The School was originally constructed in 1970 with major renovations in 2002 and 2009. The building's heating and cooling sources are located at the central plant delivering chilled and hot water to the building equipment.

SMYRNA HIGH SCHOOL BUILDING INFORMATION	
Address	500 Duck Creek Parkway, Smyrna, DE
Year Constructed, Renovations/Additions	1970, 2002, 2009
Building Area	355,960 SQ-FT
System Types	4-Pipe system served by The Central Plant.
Survey Date	11-Jul-18
Point of Contact	Scott Holmes

The majority of building systems are in good shape and have been well maintained or refurbished, however there a few systems that will require either replacement, repair and/or redesign.

1.2 Anticipated Lifecycle Replacement

ANTICIPATED LIFECYCLE REPLACEMENT	
Priority	System / Equipment / Component / Repair
Immediate	Area 'D' Ventilation and Economizer, Air Handling Units, DX Split System Units, Fans
Short-Term	Exterior Disconnect Switches at exterior HVAC units that are replaced
Mid-Term	Fan Coil Units, DX Split Units, Fans, Heaters, Special Systems, Int. and Ext. Lighting
Long-Term	Pumps, Air Handling Units, Energy Recovery Units, Terminal Units, Split-Systems, Packaged Units, Make-up Air Units, Fans, Unit Heaters, Air Separators, Expansion Tanks, Controls, Switchboards, Panelboards, Generator, Automatic Transfer Switch (ATS), Receptacles, Wiring, Fire Alarm

1.3 Cost Estimates

COST ESTIMATE		
#	Description	Estimated Project Cost
1	Area 'D' Ventilation Redesign	\$ 1,903,500.00
2	<u>AHU-307</u> Art Room Air Handler Replacement	\$ 108,550.00
3	<u>AHU-703</u> Auditorium Lobby Air Handler Replacement	\$ 149,550.00
4	<u>Unlabeled</u> Area 'D' Split DX Air Conditioner Replacement	\$ 13,380.00
5	<u>AC-104</u> Packaged DX Air Conditioner Replacement	\$ 77,400.00
6	<u>AC-105</u> Packaged DX Air Conditioner Replacement	\$ 95,850.00
7	Replace Aging Exhaust Fans and Gravity Hoods	\$ 114,000.00
8	Storm Water System Study and Replacement	\$ 37,000.00
9	Proposed Technology Improvements	\$ 1,047,100.00
10	<u>AHU-103</u> Cafeteria Rooftop Air Handler Replacement	\$ 194,750.00
Total		\$ 3,546,330.00

2 SCOPE AND METHODOLOGY

2.1 Scope

The scope of this report is to assess the condition of existing MEP systems and provide the Smyrna School District a means to prioritize upgrades.

2.2 Methodology

Gipe Associates has made assessments and recommendations based on (4) main factors which include:

- Onsite surveys of equipment by visual inspection.
- Review of the existing MEP drawings provided by the Smyrna School District.
- Interviews with Maintenance Staff to identify chronic system issues, regular maintenance schedules and historical system operation.
- American Society of Heating, Refrigerating and Air Conditioning Engineers (ASHRAE) Service Life Database (<https://xp20.ashrae.org/publicdatabase/>).

From these sources, judgements are made to assess equipment condition and determine the expected useful life remaining for MEP systems for this geographical location and use type. Condition assessments have been grouped in order of priority as defined in the next section.

2.3 Condition Assessment Priority Definitions

Code	Priority	Description
P-01	Immediate	Items that are currently overdue or that will be required within the next year (FY19). Equipment condition is either non-operational, in poor condition or not meeting performance needs.
P-02	Short-Term	Items that will be required within the next 2-3 years (FY20-FY22). Equipment condition is fair, signs of wear but still satisfactory as-is, additional maintenance and repair may be required as it continues to age.
P-03	Mid-Term	Items that will be required within the next 4-5 years (FY23-FY25). Equipment condition is good, performing satisfactory and expected to reach its estimated service life with regularly scheduled maintenance.
P-04	Long-Term	Items that will be required 5-10 years in the future (FY26+). Equipment condition is good – excellent, and has many years of useful service life remaining.

The next section tabulates all major equipment, capacities and condition assessments with a priority code.

3 MECHANICAL AND PLUMBING SYSTEMS

Overall, the mechanical/plumbing systems and equipment appear to be well maintained and functioning adequately with exceptions in Area 'D', the Art Room, Auditorium and various rooftop equipment.

Interviews with maintenance staff reported (2) major chronic system problems:

- Area 'D' HVAC comfort and ventilation issues.
- Storm Water backup on the southeast side of the building.

Currently, there are no planned construction projects to expand or renovate the High School in any major way. Gipe is currently working on a design solution to address ventilation problems in Area 'D' classrooms, the extent of that project will be detailed in the following sections.

Equipment condition and age vary throughout the building, but the majority of the equipment has been either replaced or refurbished within the last 20 years. All systems and equipment are maintained by in-house staff. All service records, engineering drawings, and installation manuals have been maintained and filed on-site.

3.1 Heating, Ventilating and Air Conditioning (HVAC)

The building utilizes a 4-pipe HVAC system with primary chilled and hot water pumped from the Central Plant to secondary pumps located in mechanical rooms onsite. Air handlers are located throughout the building in mechanical mezzanines, closets, and on the roof. A typical 4-pipe air handler is illustrated in Figure 1.

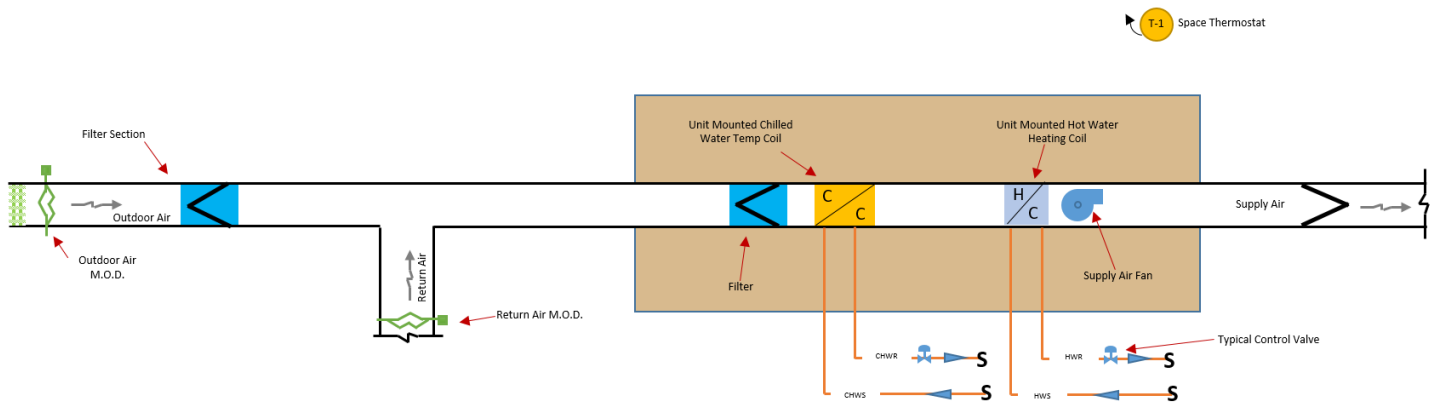


Figure 1: Typical 4-Pipe Air Handling Unit Diagram

The newer 'A/B/C' sections of the building have 4-pipe variable air volume (VAV) systems to distribute conditioned air to classrooms and administrative offices. Ventilation is provided by Energy Recovery Units (ERU) which recover energy from building exhaust and utilize the same to pre-condition outside air.

Hydronic heating water is also circulated to reheat coils, fin-tube radiators and radiant heated floors.

Older classroom sections of the building rely on 4-pipe Unit Ventilators (UV) for space conditioning and ventilation similar to Figure #1.

Large specialty spaces such as the Gyms, Auditorium and Cafeteria have dedicated 4-pipe Air Handling Units (AHUs).

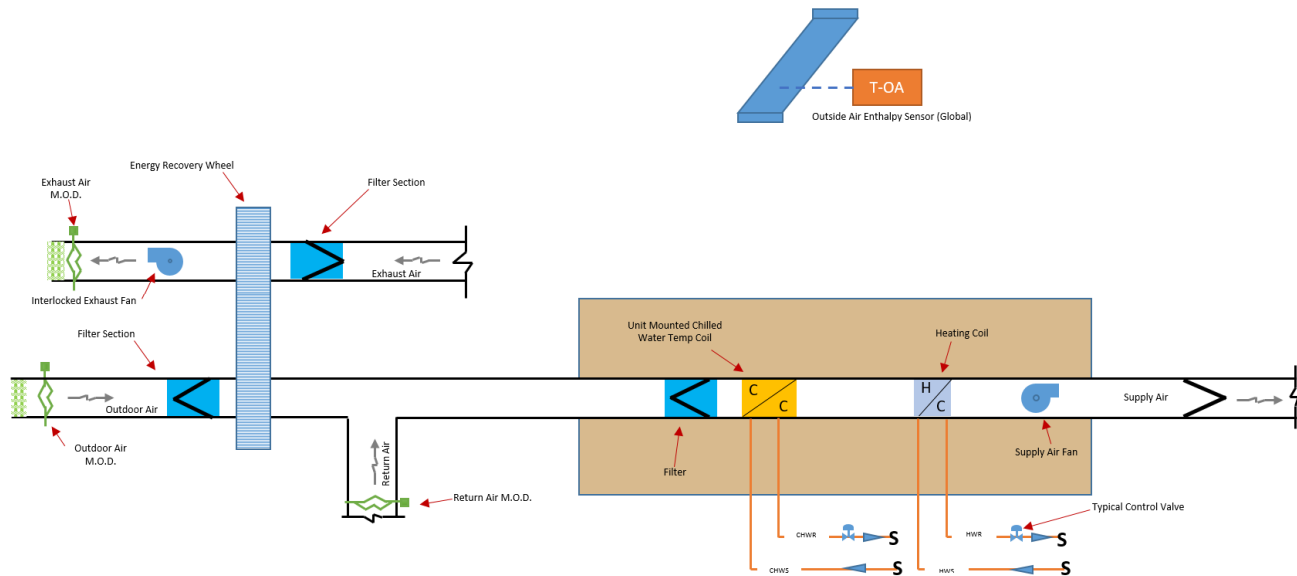


Figure 2: Typical Energy Recovery Air Handling Unit Diagram

The following tables contain information about each type of equipment and condition/priority.

HYDRONIC DISTRIBUTION		
Equipment Type	Service Life Estimate (years)	
Pump(s), Base-mounted	20	
P-04	Quantity	4
	Capacity	10 - 40 HP
	Control	Variable Speed, 2-way Control Valves
	Location	Mechanical Room
	Service	Heating Water Secondary Circulation
	Nameplate Date	2009
P-04	Quantity	4
	Capacity	20 - 75 HP
	Control	Variable Speed, 2-way Control Valves
	Location	Mechanical Room
	Service	Chilled Water Secondary Circulation
	Nameplate Date	2009
Pump(s), Inline	18	
P-04	Quantity	2
	Capacity	0.5 HP each
	Control	Variable Speed, 2-way Control Valves
	Location	Mechanical Room
	Service	Radiant Floor Circulation
	Nameplate Date	2009

AIR DISTRIBUTION SYSTEMS		
Equipment Type	Service Life Estimate (years)	
Air Handling Unit(s), Variable Volume		
24		
P-01	Quantity	5
	Capacity	2,350 - 6,750 cfm
	Location	Roof
	Service	Area 'D' Classrooms
	Nameplate Date	2012
P-04	Quantity	9
	Capacity	1,820 - 10,350 cfm
	Location	Roof, Mechanical Mezzanines, Ceiling Plenum
	Service	Health Wing, Gym Lobbies, Wings 'A/B/C', Band Room, Shop Classrooms
	Nameplate Date	2009; 2012
Air Handling Unit(s), Constant Volume		
24		
P-04	Quantity	8
	Capacity	2,300 cfm - 6,300
	Location	Auditorium Mechanical Mezzanines, Roof
	Service	Auditorium, Athletic, 'J' Gym Lobby
	Nameplate Date	2009; 2012
P-04	Quantity	2
	Capacity	3,990; 4,000 cfm
	Location	Roof Penthouse, Ceiling Plenum
	Service	Fitness Room, Welding Shop
	Nameplate Date	2002
P-01	Quantity	3
	Capacity	3,460; 4,700; 10,000 cfm
	Location	Above Ceiling, Roof
	Service	Art Room, Auditorium Lobby, Cafeteria
	Nameplate Date	1970, 2002
Air Handling Unit(s), Energy Recovery		
24		
P-04	Quantity	11
	Capacity	4,575 - 27,140 cfm
	Location	Roof, Mechanical Mezzanines
	Service	Kitchen, Cafeteria, Gyms, Locker Rooms, Art Wing, Wings 'A/B/C'
	Nameplate Date	2009

TERMINAL UNITS	
Equipment Type	Service Life Estimate (years)
Air Terminal, VAV box	
P-04	Quantity
	79
	Capacity
	250 - 2,325 cfm
	Location
	Ceiling Plenum
	Service
	A/B/C Wing classrooms and administration area
	Nameplate Date
	2009
Air Terminal, Unit Ventilator	
20	
P-04	Quantity
	82
	Capacity
	750 - 1,500 cfm
	Location
	Exterior Walls, Ceiling
	Service
	Classrooms Area 'D/E/F'
	Nameplate Date
	2009,2012
Air Terminal, Fan Coil Unit	
20	
P-04	Quantity
	32
	Capacity
	150 - 1,000 cfm
	Location
	Ceiling Mounted, Wall Mounted
	Service
	Stairwells, Corridors, Specialty Rooms
	Nameplate Date
	2009
P-03	Quantity
	26
	Capacity
	200 - 1,000 cfm
	Location
	Ceiling Mounted, Wall Mounted
	Service
	Stairwells, Corridors, Specialty Rooms
	Nameplate Date
	2002
Air Terminal, Blower Coil Unit	
20	
P-04	Quantity
	4
	Capacity
	600 - 1,900 cfm
	Location
	Ceiling Plenum
	Service
	Training Rooms
	Nameplate Date
	2009

SUPPLEMENTAL UNITS		
Equipment Type	Service Life Estimate (years)	
Split DX Unit, air-cooled		
17		
P-04	Quantity	18
	Capacity	9.0 - 36.0 MBH
	Refrigerant	R-410A
	Location	Roof
	Service	MDFs, IDFs, Area 'D', Area 'E', Gym Lobby
	Nameplate Date	2008-2015
P-01	Quantity	1
	Capacity	12.0 MBH
	Refrigerant	R-22
	Location	Roof
	Service	Area 'D' Room
	Nameplate Date	Not Labeled
P-03	Quantity	1
	Capacity	36.0 MBH
	Refrigerant	R-410A
	Location	Roof
	Service	Area 'D' Room
	Nameplate Date	2006
Packaged DX Unit, air-cooled		
15		
P-01	Quantity	2
	Capacity	49.8 MBH; 133.5 MBH
	Refrigerant	R-22
	Location	Roof
	Service	Computer Lab, Admin Area
	Nameplate Date	2003
Radiant Heater, Hot Water		
25		
P-04	Quantity	~ 100 linear feet
	Capacity	650 BTU/ft
	Location	Wing 'A' and 'B' Admin offices
	Nameplate Date	2009
Unit Heater, Hot Water		
20		
P-04	Quantity	17
	Quantity and Capacity	14.3 - 27.4 MBH
	Location	Mechanical Rooms, Corridors
	Nameplate Date	2012
Split Refrigeration Unit, air-cooled		
17		

P-04	Quantity	2
	Quantity and Capacity	Unknown
	Refrigerant	Not Labeled
	Location	Roof
	Service	Kitchen Refrigeration
	Nameplate Date	2009
Furnace, Gas		18
P-04	Quantity	1
	Quantity and Capacity	3,600 CFM
	Location	Concessions Building
	Nameplate Date	2009
Unit Heater, Gas		13
P-03	Quantity	3
	Quantity and Capacity	30.0; 30,0; 108.0 MBH
	Location	Greenhouse, Concessions Building
	Nameplate Date	2009

VENTILATION SYSTEMS		
System or Unit Type		Service Life Estimate (years)
Make-Up Air Unit, Gas Heat		26
P-04	Quantity	2
	Capacity	3,420 CFM each
	Location	Roof
	Service	Kitchen
	Nameplate Date	2009
Fan, Centrifugal		20
P-04	Quantity	18
	Capacity	255 - 5,000 CFM
	Location	Roof, Ceiling Plenums
	Service	Toilet Rooms, Gyms, General Exhaust/Relief, Science Labs, Concessions Building
	Nameplate Date	2009
P-03	Quantity	6
	Capacity	100 - 7,000
	Location	Roof, Ceiling Plenums
	Service	Locker Rooms, General Exhaust, Welding Hoods
	Nameplate Date	2002
P-01	Quantity	10
	Capacity	200 - 2,000

	Location	Roof, Ceiling Plenums
	Service	General Exhaust, Toilet Exhaust
	Nameplate Date	1970
Fan, Axial		20
P-04	Quantity	8
	Capacity	3,005 - 12,650 CFM
	Location	Sidewall
	Service	Gym, Greenhouse
	Nameplate Date	2009

CONTROL SYSTEM		
	System or Unit Type	Service Life Estimate (years)
	Controls, Direct Digital (DDC)	25
P-04	Location	Central BAS is located in Central Plant
	Service	All major equipment is connected to BAS Control Panels
	Nameplate Date	2009

Planned Improvements

The following items have been identified by the maintenance staff as previously budgeted, approved projects that will be completed in the near term:

- Upgraded BAS front end software (Allerton Compass)

Deferred Maintenance and Replacement

The following items have been identified either during the survey effort or by the maintenance staff as items that require immediate repair or replacement:

- Area 'D' Ventilation Redesign. Currently, outside air is provided to classroom UVs through a manifolded duct system that lacks proper controls to separately damper each UV intake. To solve this Gipe is redesigning the system to replace rooftop units (RTU), shown in Photograph #1, with ERUs to provide conditioned OA to each UV and eliminate their economizer sequence.



Photograph 1: Typical Existing RTU

- AHU-307 serves the Art Room in area 'E' and is original to the building (1970). It has been overlooked in all major HVAC renovations. It should be replaced with a new 4-pipe air handler.

- AHU-703 serves the Auditorium Lobby in area 'E' and is original to the building (1970). It has been overlooked in all major HVAC renovations. Currently the maintenance staff has shut-down this unit. It should be replaced with a new 4-pipe air handler.
- There is an unlabeled Mitsubishi split DX unit serving a room in Area 'D', as see in Photograph #2. The unit is past its useful service life and contains R-22, which is currently being phased out. It should be replaced with a new unit.



Photograph 2: Unlabeled Split DX Unit with R-22

- AHU-103 is a Rooftop Air Handling unit serving the cafeteria. The unit is past its useful service life and due for replacement.
- AC-104 is a Trane packaged DX unit serving the computer lab in Area 'F'. The unit is past its useful service life and contains R-22. It should be replaced with a new unit.
- AC-105 is a Trane packaged DX unit serving the admin area in Area 'D' on the 1st floor. The unit can be seen in Photograph #3. The unit is past its useful service life and contains R-22. It should be replaced with a new unit.



Photograph 3: Typical Packaged DX Unit

- Several rooftop fans and gravity hoods appear to be original to the building (1970). Photograph #4 shows multiple fans/hoods. Some of the fans seem to be non-operational but this has not been confirmed. Regardless, they are past their useful service life and should be replaced after investigating their need in terms of system air balancing which may have been affected with the addition of ERUs (Energy Recovery Units) in 2009.



Photograph 4: Typical Rooftop Fans and Gravity Hoods

Anticipated Lifecycle Replacement

The following list summarizes all major mechanical equipment in fair – excellent condition that will eventually require replacement, refurbishment or repair once they age past their estimated useful life.

- Pumps
- Air Handling Units
- Energy Recovery Units
- Packaged DX Units
- Split DX Units
- Unit Heaters
- Exhaust Fans
- Air Separators
- Expansion Tanks

Future Use and Replacement Recommendations

Long-Term HVAC System Recommendations

Ideally, ventilation systems and space conditioning systems are decoupled. This approach provides the most effective control over space temperature, humidity, and indoor air quality with minimal energy consumption. However, depending on life cycle costs and maintenance preferences, replacement in-kind should also be considered.

Unit Ventilators

Unit Ventilators (UV) were standard HVAC equipment for school classrooms built in the 1990's and earlier, however they have several disadvantages that are well documented compared to modern HVAC system solutions which include:

- Source of noise within the classroom

- Valuable floor space is occupied within the classroom
- Outdoor air control limitations
- Humidity control limitations

Some, if not all of these issues have been documented at SHS.

We strongly recommend refraining from UVs for all new construction and major renovations going forward. As described in the section above, a decoupled design approach is ideal.

However, since there is already a central cooling and heating plant in place with useful remaining service life, it is unrealistic to recommend a complete system replacement. The best compromise is to modify existing UV controls to only provide space cooling (no ventilation) with economizer function. New Energy Recovery Units (ERU) would be installed on the roof or in mechanical mezzanines. This system modification maximizes the use of existing equipment while decoupling ventilation and should be considered a mid-term solution until the next major renovation.

In the next section of our report we review the existing Plumbing systems and equipment.

3.2 Domestic Water Plumbing Systems

PLUMBING SYSTEMS		
Plumbing System		Description
P-04	Water Supply Piping	Copper/Galvanized Steel (6" Service)
	Waste/Sewer Piping	Cast Iron
	Vent Piping	Cast Iron/Copper
	Fire Protection	Wet Pipe Sprinkler System (6" Service)
	Water Meter Location	Mechanical Room
PLUMBING EQUIPMENT		
System or Unit Type		Service Life Estimate (years)
Domestic Hot Water Heater, natural gas		15
P-04	Quantity	6
	Input Capacity	120 - 725 MBH
	Storage Capacity	70 - 80 Gallons
	Expansion Tank?	Yes
	Location	South Mechanical Room, Science Wing, Concession
	Service	Building, Science Classrooms, Concession
	Nameplate Date	2009
Pump(s), Inline		18
P-04	Quantity	3
	Input Capacity	1/6; 2/5; 2/5 HP
	Location	South Mechanical Room, Concession
	Service	Domestic Hot Water Recirculation
	Nameplate Date	2009
Pump(s), Sump		17
P-04	Quantity	1
	Input Capacity	1/2 HP
	Location	Elevator Pit
	Service	Elevator Pit
	Nameplate Date	2009
PLUMBING FIXTURES		
Typical Plumbing Fixture		Flush Rating / Flow Rate
P-04	Water Closet	1.6 GPF
	Urinal	1.0 GPF
	Lavatory	2.2 GPM
	Janitor Sink	4.0 GPM
	Kitchen Sink	2.2 GPM
	Drinking Fountain	0.25 GPM

Planned Improvements

There are no planned improvements for the plumbing systems.

Deferred Maintenance

The following items have been identified either during the survey effort or by the maintenance staff as items that require immediate repair or replacement:

- Storm Water Study. A study is required to determine the cause and solution to storm water backup issues noticed during heavy rains. Maintenance staff reported water leaking onto the stage adjacent to the auditorium resulting in flood damage. It is likely the problem is a result of the building addition construction that took place in 2009.

Anticipated Lifecycle Replacement

The following list summarizes all major plumbing equipment which is in fair – excellent condition that will eventually require replacement, refurbishment or repair once they age past their estimated useful life.

- Water Heaters
- Recirculation Pumps
- Expansion Tanks
- Thermostatic Mixing Valves
- Plumbing Fixtures
- Piping Systems and valves

4 ELECTRICAL SYSTEMS

4.1 Electrical Service

		Equipment Type		
Overhead Conductors			X	
		Underground Conductors		
P-04	Transformer(s)	(1) 1500 kVA @ 480V, (1) 750kVA @ 208V		
	Utility Company	Town of Smyrna		
	Service Size	(1) 2,000A @ 480V, (1) 1,600A @ 208V		
	Meter	Primary Meter		
	Location	Mounted on side of Primary Metering Station at back of property		
	Main Switchboard(s)	(1) MPS – 2000A @ 480V, (1) MDS – 1600A @ 208V		
	Manufacturer	Square D	Installation Date	5/2010
	Condition	P-04		

		Equipment Type	
Panelboard(s)		Distribution – HCP, Branch Panelboards – NF or NQ	
P-04	Manufacturer	Square D	

The building has a 2,000A, 277/480V, three phase switchboard and a 1,600A, 120/208V, three phase switchboard located in the main electrical room. Based on information we received from the Town of Smyrna, the peak demand for the building in the last 12 months is 1,290 kW which converts to 1,553 Amperes (A). The existing two main switchboards have a combined maximum capacity of 2,880A. With the school having a primary meter located ahead of the pad mounted transformers that serve the school, we are not able to determine the peak demand on each switchboard. However, it appears that the existing switchboards have adequate space and capacity to support additional load.

There are no immediate or significant repairs that need to be made to the electrical service or panelboards. There are a few panelboards that are manufactured by GE and were installed in 2003, but the majority of the panelboards throughout the school are manufactured by Square D and were installed in 2010 and appear to be in good condition.

4.2 Emergency Power

		Equipment Type	
Generator Equipment			
P-04	Manufacturer	Kohler	
	Size	350kW	
	Fuel Type	Diesel	
P-04	ATS (Manufacturer)	Kohler – (1) 400A (Life Safety), (1) 800A (Standby)	

The generator that serves the high school is located at the Central Plant building and serves that building as well.

4.3 Lighting Systems

Equipment Type		
Lighting Systems		
P-03	Interior Lighting	Type: Linear Fluorescent, T8, T5, U-lamp fixtures
P-03	Exterior Lighting	Type: Wall mounted, parking lot poles with Metal Halide lamp(s)
P-04	Emergency Lighting	Type: General light fixtures fed from generator via Bodine Emergency Lighting Relay Control Device
	Illuminated Exit Signs	Yes
Switches		
P-04	Lighting Switches (Mounting Height)	46" to center of switch
P-04	Lighting Switches (Mounting Height) ADA Compliant	Yes

While the lighting systems are not in immediate need of replacement, as part of general improvements to the building, changing from fluorescent and metal halide lighting to LED lighting would result in energy savings. Also installing lighting controls such as occupancy sensors in the classrooms throughout the building could increase energy savings as the current classrooms do not have an automatic means to turn off the lights in that space when that space is unoccupied. The current lighting controls does not comply with the current edition of ASHRAE 90.1. Routine and periodic maintenance of the lighting system is recommended.

4.4 Power

Equipment Type		
Power		
P-04	GFCI receptacles at required locations	Yes
	Duplex receptacles (Grounding or no)	Grounding
	Duplex receptacles at HVAC equipment	Yes
	Building Wire	Copper
	Condition of Step-Down Transformers	Good condition
	Condition of interior disconnect switches	Good condition
P-02	Condition of exterior disconnect switches	Replace exterior disconnects for all HVAC units that are replaced. Otherwise exterior disconnect switches to remain.

4.5 Special Systems

Equipment Type		
Special Systems		
P-03	Telephone Entrance	MDF Room
	Cable TV Service	Yes, MDF Room
	Fiber/Data on site	Yes, MDF Room
	Data racks (Location or spare capacity)	MDF or IDF Rooms – Yes spare capacity
	MDF Room Conditioned	Yes
	Ground Bar in MDF Room	Yes
	Data Cabling	CAT 5
	CCTV	Yes
	Security (Manufacturer)	Honeywell
	Intercom (Aiphone)	No
	Card Reader(s)	Yes

There are no immediate or significant repairs that need to be made to the building receptacles, however, some of the existing disconnect switches on the roof are showing signs of aging due to exposure to the weather elements and may need to be replaced in the next 2-3 years. We would recommend that new NEMA 4X, stainless steel disconnects be provided for all exterior HVAC equipment that is replaced. The technology department has some planned improvements for buildings special systems as outlined below in the planned improvements section of this report.

4.6 Fire Alarm System

Equipment Type		
Fire Alarm System		
Item	Item Provided?	
	Yes	No
P-04	Horns or Bells	X
	Strobe Lights	X
	Voice Evacuation	X
	Battery Back-up	X
	Automatic Dialer	X
	Smoke Detectors	X
	Outdoor Bell	X
	Duct Detectors	X
	Manual Stations at Exit	X
	Manual Station Mounting Height ADA compliant	X
	Location of FACP	IDF Room to the right of the auditorium
	Smoke Detector at FACP	Yes
	Fire Alarm (Addressable or Analog)	Addressable
	Manufacturer	Gamewell by Honeywell
	Date of Installation	2010
Annunciator		
P Remote Annunciator	Yes	

	Annunciator (Graphic or Alphanumeric)	Alphanumeric
	Annunciator Location	Front Lobby

There are no immediate or significant repairs that need to be made to the building fire alarm system. Routine and periodic testing and maintenance of the fire alarm system is recommended.

4.7 Code Deficiencies

1. In the building main electrical room, the lighting in the space is controlled only by a ceiling occupancy sensor that turns the lights on once you enter the room. The current code requires that a manual means to bypass the automatic control be provided.

Planned Improvements

- Add six (6) additional external and one (1) additional internal cameras in areas designated by the school administrators.
- Upgrade fiber cabling between MDF and IDF rooms to OM4.
- Upgrade cabling between data closets and network drops to Category-6 copper cabling.
- Add wireless access points to non-educational (cafeteria, gym, guidance office) spaces. (cost estimate based on 30)
- Provide uninterruptible power supply (UPS) at all access door control panels. (cost estimate based on 40)

Deferred Maintenance

There are no deferred maintenance items for the electrical system.

General Improvements

- Replace interior and exterior lighting with LED fixtures.
- Provide lighting controls throughout the building to automatically turn lights off in spaces that are empty.

Anticipated Lifecycle Replacement

The following list summarizes all major equipment that is currently in fair – excellent condition that will eventually need replacement

- Switchboard(s)
- Panelboard(s)
- Step-down Transformers
- Generator
- Automatic Transfer Switch (ATS)
- Lighting
- Receptacles
- Fire Alarm Panel
- Security System
- Video Cameras

APPENDIX A

FACILITY PHOTOGRAPHS



Photo #1 Area A Mechanical Room Domestic Water Heaters



Photo #2 Area A Mechanical Room Secondary Chilled Water Pumps



Photo #3 Area A Mechanical Room Secondary



Photo #4 Area H Room Domestic Water Heaters



Photo #5 Area H Mechanical Room Secondary Heating and Cooling Pumps



Photo #6 Concessions Building

Appendix A

Smyrna High School Mechanical Photographs



Photo #7 Entrance Exterior



Photo #8 Fire Pump Controller



Photo #9 Fire Pump Room



Photo #10 Kitchen Refrigeration Condensing Units



Photo #11 Main Gym Entrance



Photo #12 Typical Packaged DX Roof Top Unit

Appendix A

Smyrna High School Mechanical Photographs



Photo #13 P-01 (Rooftop CU-P-01.5 with R-22)



Photo #14 P-01.1 and P01.2 (RTU)



Photo #15 P-01.8 (EFs)



Photo #16 Typical Auditorium Air Handling Unit



Photo #17 Typical Classroom Horizontal Unit Ventilator



Photo #18 Typical Classroom Sink



Photo #19 Typical DX Split System Condensing Units



Photo #20 Typical Indoor Air Handling Unit



Photo #21 Typical Kitchen Make-Up Air Unit



Photo #22 Typical Lab Exhaust Hood



Photo #23 Typical Lab Hood Inline Exhaust Fans



Photo #24 Typical Lavatory



Photo #25 Typical Mechanical Mezzanine



Photo #26 Typical Rooftop Air Handling Unit



Photo #27 Typical Rooftop Energy Recovery Unit



Photo #28 Typical Rooftop Exhaust Fan



Photo #29 Typical Urinal

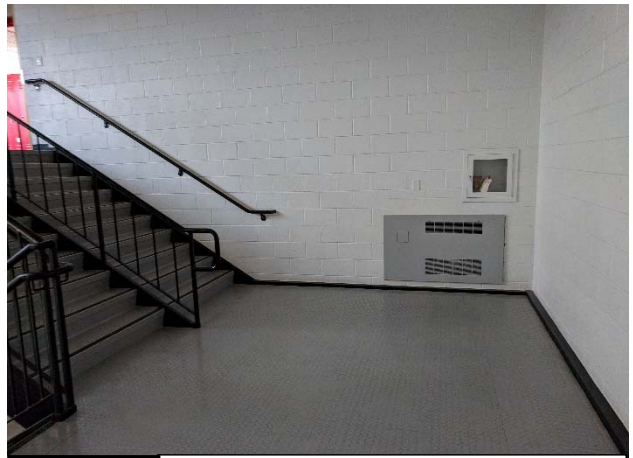


Photo #30 Typical Wall Recessed Heater



Photo #31 Typical Water Closet



Photo #1 Fire Alarm Control Panel



Photo #2 Disconnects on roof showing rust and wear



Photo #3 Lobby Annunciator Panel and Rescue Assistance



Photo #4 Switchboard MPS



Photo #5

Typical Interior Motor Controller



Photo #6

Typical Transfer Switch

APPENDIX B

COST ESTIMATE



Gipe Associates, Inc.
CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 77,000
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

1 - AREA 'D' VENTILATION REDESIGN	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

DUCTWORK DEMOLITION	1.0	LS		\$ -	\$ 15,000.00	\$ 15,000.00	\$ 15,000.00
RTU REMOVAL	5.0	EA		\$ -	\$ 1,500.00	\$ 7,500.00	\$ 7,500.00
RELIEF HOOD REMOVAL	5.0	EA		\$ -	\$ 1,000.00	\$ 5,000.00	\$ 5,000.00
EXHAUST FAN REMOVAL	3.0	EA		\$ -	\$ 500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 5,000.00	\$ 5,000.00	\$ 5,000.00
AIR TRANSFERS DEMOLITION	1.0	LS		\$ -	\$ 7,500.00	\$ 7,500.00	\$ 7,500.00
FIX UNIT VENTS TO BE RECIRCULATING ONLY	66.0	EA	\$ 500.00	\$ 33,000.00	\$ 500.00	\$ 33,000.00	\$ 66,000.00
ERV UNIT	4.0	EA	\$ 135,000.00	\$ 540,000.00	\$ 25,000.00	\$ 100,000.00	\$ 640,000.00
DUCTWORK FOR ERV	1.0	LS	\$ 280,000.00	\$ 280,000.00	\$ 420,000.00	\$ 420,000.00	\$ 700,000.00
CHILLED WATER AND HEATING WATER PIPING, VALVES AND FITTINGS	1.0	LS	\$ 20,000.00	\$ 20,000.00	\$ 27,000.00	\$ 27,000.00	\$ 47,000.00
DUCT DETECTORS	8.0	EA	\$ 300.00	\$ 2,400.00	\$ 500.00	\$ 4,000.00	\$ 6,400.00
FREEZE PROTECTION PUMPS	8.0	EA	\$ 1,500.00	\$ 12,000.00	\$ 1,000.00	\$ 8,000.00	\$ 20,000.00
ERV ATC CONTROLS	1.0	LS	\$ 75,000.00	\$ 75,000.00	\$ 125,000.00	\$ 125,000.00	\$ 200,000.00
PIPING INSULATION	1.0	LS	\$ 11,000.00	\$ 11,000.00	\$ 14,000.00	\$ 14,000.00	\$ 25,000.00
DUCT INSULATION	1.0	LS	\$ 20,000.00	\$ 20,000.00	\$ 25,000.00	\$ 25,000.00	\$ 45,000.00
CONDENSATE PIPING	1.0	LS	\$ 2,500.00	\$ 2,500.00	\$ 3,000.00	\$ 3,000.00	\$ 5,500.00
FIRE DAMPERS	1.0	LS	\$ 5,000.00	\$ 5,000.00	\$ 7,500.00	\$ 7,500.00	\$ 12,500.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 25,000.00	\$ 25,000.00	\$ 25,000.00
COMMISSIONING	1.0	LS		\$ -	\$ 20,000.00	\$ 20,000.00	\$ 20,000.00
ELECTRICAL DISCONNECTS	4.0	EA	\$ 1,000.00	\$ 4,000.00	\$ 500.00	\$ 2,000.00	\$ 6,000.00
MOTOR CONTROLLERS	8.0	EA	\$ 500.00	\$ 4,000.00	\$ 500.00	\$ 4,000.00	\$ 8,000.00
CONDUIT AND WIRE	8.0	LS	\$ 1,700.00	\$ 13,600.00	\$ 2,200.00	\$ 17,600.00	\$ 31,200.00
FIREALARM INTERFACE OF DUCT DETECTORS	8.0	EA	\$ 300.00	\$ 2,400.00	\$ 250.00	\$ 2,000.00	\$ 4,400.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 1,024,900.00	\$ 878,600.00	\$ 1,903,500.00
TOTAL BASE BID:	\$ 1,024,900.00	\$ 878,600.00	\$ 1,903,500.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$13.31 PER S.F.	\$11.41 PER S.F.	\$24.72 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 1,903,500.00	\$24.72 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 2,500
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

2 - AHU-307 REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	TOTAL COST
DUCTWORK DEMOLITION	1.0	LS		\$ -	\$ 5,000.00	\$ 5,000.00	\$ 5,000.00
AHU REMOVAL	1.0	EA		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
INDOOR AHU UNIT (3,500 CFM)	1.0	EA	\$ 18,000.00	\$ 18,000.00	\$ 10,000.00	\$ 10,000.00	\$ 28,000.00
DUCTWORK FOR AHU	1.0	LS	\$ 5,000.00	\$ 5,000.00	\$ 12,000.00	\$ 12,000.00	\$ 17,000.00
CHILLED WATER AND HEATING WATER PIPING, VALVES AND FITTINGS	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 500.00	\$ 1,000.00	\$ 1,600.00
AHU ATC CONTROLS	1.0	LS	\$ 7,000.00	\$ 7,000.00	\$ 10,000.00	\$ 10,000.00	\$ 17,000.00
PIPING INSULATION	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT INSULATION	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
CONDENSATE PIPING	1.0	LS	\$ 500.00	\$ 500.00	\$ 750.00	\$ 750.00	\$ 1,250.00
FREEZE PROTECTION PUMPS	1.0	EA	\$ 900.00	\$ 900.00	\$ 2,800.00	\$ 2,800.00	\$ 3,700.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 5,000.00	\$ 5,000.00	\$ 5,000.00
COMMISSIONING	1.0	LS		\$ -	\$ 5,000.00	\$ 5,000.00	\$ 5,000.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
MOTOR CONTROLLERS	1.0	EA	\$ 500.00	\$ 500.00	\$ 500.00	\$ 500.00	\$ 1,000.00
CONDUIT AND WIRE	1.0	EA	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00
FIREALARM INTERFACE OF DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 250.00	\$ 500.00	\$ 1,100.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 41,800.00	\$ 66,750.00	\$ 108,550.00
TOTAL BASE BID:	\$ 41,800.00	\$ 66,750.00	\$ 108,550.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$16.72 PER S.F.	\$26.70 PER S.F.	\$43.42 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 108,550.00	\$43.42 PER S.F.



Gipe Associates, Inc.
CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 4,000
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

3 - AHU-703 REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

DUCTWORK DEMOLITION	1.0	LS		\$ -	\$ 5,000.00	\$ 5,000.00	\$ 5,000.00
AHU REMOVAL	1.0	EA		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
INDOOR AHU UNIT (4,700 CFM)	1.0	EA	\$ 60,000.00	\$ 60,000.00	\$ 10,000.00	\$ 10,000.00	\$ 70,000.00
DUCTWORK FOR AHU	1.0	LS	\$ 10,000.00	\$ 10,000.00	\$ 10,000.00	\$ 10,000.00	\$ 20,000.00
CHILLED WATER AND HEATING WATER PIPING, VALVES AND FITTINGS	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 500.00	\$ 1,000.00	\$ 1,600.00
AHU ATC CONTROLS	1.0	LS	\$ 7,000.00	\$ 7,000.00	\$ 10,000.00	\$ 10,000.00	\$ 17,000.00
PIPING INSULATION	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT INSULATION	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
CONDENSATE PIPING	1.0	LS	\$ 500.00	\$ 500.00	\$ 750.00	\$ 750.00	\$ 1,250.00
FREEZE PROTECTION PUMPS	1.0	EA	\$ 900.00	\$ 900.00	\$ 2,800.00	\$ 2,800.00	\$ 3,700.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 3,000.00	\$ 3,000.00	\$ 3,000.00
COMMISSIONING	1.0	LS		\$ -	\$ 3,000.00	\$ 3,000.00	\$ 3,000.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
MOTOR CONTROLLERS	1.0	EA	\$ 500.00	\$ 500.00	\$ 500.00	\$ 500.00	\$ 1,000.00
CONDUIT AND WIRE	1.0	EA	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00
FIREALARM INTERFACE OF DUCT	2.0	EA	\$ 300.00	\$ 600.00	\$ 250.00	\$ 500.00	\$ 1,100.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 88,800.00	\$ 60,750.00	\$ 149,550.00
TOTAL BASE BID:	\$ 88,800.00	\$ 60,750.00	\$ 149,550.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$22.20 PER S.F.	\$15.19 PER S.F.	\$37.39 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 149,550.00	\$37.39 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 500
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

4 - DX SPLIT SYSTEM REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	TOTAL COST
DX SPLIT SYSTEM REMOVAL	1.0	EA		\$ -	\$ 500.00	\$ 500.00	\$ 500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 200.00	\$ 200.00	\$ 200.00
DUCTLESS INDOOR AHU UNIT	1.0	EA	\$ 1,500.00	\$ 1,500.00	\$ 300.00	\$ 300.00	\$ 1,800.00
ROOF MOUNTED OUTDOOR UNIT (18MBH)	1.0	LS	\$ 3,000.00	\$ 3,000.00	\$ 300.00	\$ 300.00	\$ 3,300.00
REFRIGERANT PIPING	1.0	LS	\$ 300.00	\$ 300.00	\$ 300.00	\$ 300.00	\$ 600.00
PIPING INSULATION	20.0	LF	\$ 10.00	\$ 200.00	\$ 4.00	\$ 80.00	\$ 280.00
CONDENSATE PIPING	20.0	LF	\$ 5.00	\$ 100.00	\$ 10.00	\$ 200.00	\$ 300.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 500.00	\$ 500.00	\$ 500.00
COMMISSIONING	1.0	LS		\$ -	\$ 500.00	\$ 500.00	\$ 500.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
CONDUIT AND WIRE	1.0	LS	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 7,800.00	\$ 5,580.00	\$ 13,380.00
TOTAL BASE BID:	\$ 7,800.00	\$ 5,580.00	\$ 13,380.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$15.60 PER S.F.	\$11.16 PER S.F.	\$26.76 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 13,380.00	\$26.76 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 5,000
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

5 - AC-104 REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

DUCTWORK DEMOLITION	1.0	LS		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
RTU REMOVAL	1.0	EA		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 500.00	\$ 500.00	\$ 500.00
PACKAGED RTU (60 MBH)	1.0	EA	\$ 24,000.00	\$ 24,000.00	\$ 10,000.00	\$ 10,000.00	\$ 34,000.00
DUCTWORK FOR RTU	1.0	LS	\$ 10,000.00	\$ 10,000.00	\$ 5,000.00	\$ 5,000.00	\$ 15,000.00
GAS PIPING, VALVES AND FITTINGS	1.0	LS	\$ 500.00	\$ 500.00	\$ 1,500.00	\$ 1,500.00	\$ 2,000.00
DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 1,000.00	\$ 2,000.00	\$ 2,600.00
RTU ATC CONTROLS	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT INSULATION	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
CONDENSATE PIPING	20.0	LF	\$ 5.00	\$ 100.00	\$ 10.00	\$ 200.00	\$ 300.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
COMMISSIONING	1.0	LS		\$ -	\$ 2,500.00	\$ 2,500.00	\$ 2,500.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
CONDUIT AND WIRE	1.0	LS	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00
FIREALARM INTERFACE OF DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 250.00	\$ 500.00	\$ 1,100.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 42,500.00	\$ 34,900.00	\$ 77,400.00
TOTAL BASE BID:	\$ 42,500.00	\$ 34,900.00	\$ 77,400.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$8.50 PER S.F.	\$6.98 PER S.F.	\$15.48 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 77,400.00	\$15.48 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 3,500
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

6 - AC-105 REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	TOTAL COST
DUCTWORK DEMOLITION	1.0	LS		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
RTU REMOVAL	1.0	EA		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	LS		\$ -	\$ 500.00	\$ 500.00	\$ 500.00
PACKAGED RTU (140 MBH)	1.0	EA	\$ 30,000.00	\$ 30,000.00	\$ 14,000.00	\$ 14,000.00	\$ 44,000.00
DUCTWORK FOR RTU	1.0	LS	\$ 15,000.00	\$ 15,000.00	\$ 7,000.00	\$ 7,000.00	\$ 22,000.00
GAS PIPING, VALVES AND FITTINGS	1.0	LS	\$ 750.00	\$ 750.00	\$ 2,200.00	\$ 2,200.00	\$ 2,950.00
DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 500.00	\$ 1,000.00	\$ 1,600.00
RTU ATC CONTROLS	1.0	LS	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT INSULATION	1.0	LS	\$ 3,000.00	\$ 3,000.00	\$ 3,500.00	\$ 3,500.00	\$ 6,500.00
CONDENSATE PIPING	20.0	LF	\$ 5.00	\$ 100.00	\$ 10.00	\$ 200.00	\$ 300.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
COMMISSIONING	1.0	LS		\$ -	\$ 2,500.00	\$ 2,500.00	\$ 2,500.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
CONDUIT AND WIRE	1.0	LS	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00
FIREALARM INTERFACE OF DUCT DETECTORS	2.0	EA	\$ 300.00	\$ 600.00	\$ 250.00	\$ 500.00	\$ 1,100.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 54,750.00	\$ 41,100.00	\$ 95,850.00
TOTAL BASE BID:	\$ 54,750.00	\$ 41,100.00	\$ 95,850.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$15.64 PER S.F.	\$11.74 PER S.F.	\$27.39 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 95,850.00	\$27.39 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE
EASTON, MARYLAND
PHONE: 410-822-8688
FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
GAI PROJECT NO: 18047
DATE: 07/27/18
PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 10,000
FACILITY TYPE: EDUCATION - CLASSROOMS
OF FLOORS: 2
ARCHITECT: FEARN-CLENDANIEL
BASIS FOR ESTIMATE: CERT. OF NECESSITY
SUMMARY: PRELIMINARY ESTIMATE

7 - EF AND GH REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	TOTAL COST
DUCTWORK DEMOLITION	10.0	EA		\$ -	\$ 500.00	\$ 5,000.00	\$ 5,000.00
EF REMOVAL	10.0	EA		\$ -	\$ 500.00	\$ 5,000.00	\$ 5,000.00
GRAVITY HOOD REMOVAL	10.0	EA		\$ -	\$ 500.00	\$ 5,000.00	\$ 5,000.00
NEW EXHAUST FANS	10.0	EA	\$ 1,500.00	\$ 15,000.00	\$ 1,000.00	\$ 10,000.00	\$ 25,000.00
DUCTWORK FOR EF	1.0	LS	\$ 5,000.00	\$ 5,000.00	\$ 10,000.00	\$ 10,000.00	\$ 15,000.00
GRAVITY HOODS	10.0	EA	\$ 250.00	\$ 2,500.00	\$ 250.00	\$ 2,500.00	\$ 5,000.00
EXHAUST FAN ATC CONTROLS	1.0	LS	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00	\$ 5,000.00	\$ 8,000.00
TESTING AND BALANCING	1.0	LS		\$ -	\$ 8,000.00	\$ 8,000.00	\$ 8,000.00
COMMISSIONING	1.0	LS		\$ -	\$ 3,000.00	\$ 3,000.00	\$ 3,000.00
MOTOR CONTROLLERS	10.0	EA	\$ 500.00	\$ 5,000.00	\$ 500.00	\$ 5,000.00	\$ 10,000.00
CONDUIT AND WIRE	10.0	LS	\$ 1,000.00	\$ 10,000.00	\$ 1,500.00	\$ 15,000.00	\$ 25,000.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 40,500.00	\$ 73,500.00	\$ 114,000.00
TOTAL BASE BID:	\$ 40,500.00	\$ 73,500.00	\$ 114,000.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$4.05 PER S.F.	\$7.35 PER S.F.	\$11.40 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 114,000.00	\$11.40 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE

EASTON, MARYLAND

PHONE: 410-822-8688

FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
 GAI PROJECT NO: 18047
 DATE: 07/27/18
 PREPARED BY:

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 10,000
 FACILITY TYPE: EDUCATION - CLASSROOMS
 # OF FLOORS: 2
 ARCHITECT: FEARN-CLENDANIEL
 BASIS FOR ESTIMATE: CERT. OF NECESSITY
 SUMMARY: PRELIMINARY ESTIMATE

8 - STORM WATER STUDY AND REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

STUDY / CALCS	1.0	EA		\$ -	\$ 7,000.00	\$ 7,000.00	\$ 7,000.00
STORM WATER REPLACEMENT ALLOWANCE	1.0	LS	\$ 10,000.00	\$ 10,000.00	\$ 20,000.00	\$ 20,000.00	\$ 30,000.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 10,000.00	\$ 27,000.00	\$ 37,000.00
TOTAL BASE BID:	\$ 10,000.00	\$ 27,000.00	\$ 37,000.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$1.00 PER S.F.	\$2.70 PER S.F.	\$3.70 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 37,000.00	\$3.70 PER S.F.



Gipe Associates, Inc.

CONSULTING ENGINEERS

Mechanical | Electrical | Plumbing

8719 BROOKS DRIVE

EASTON, MARYLAND

PHONE: 410-822-8688

FAX: 410-822-6306

CONSTRUCTION COST ESTIMATE

PROJECT: SMYRNA HIGH SCHOOL
 GAI PROJECT NO: 18047
 DATE: 08/08/19
 PREPARED BY: MEO

GENERAL PROJECT INFORMATION

PROJECT SQUARE FOOTAGE: 5,000
 FACILITY TYPE: EDUCATION - CLASSROOMS
 # OF FLOORS: 2
 ARCHITECT: FEARN-CLENDANIEL
 BASIS FOR ESTIMATE: CERT. OF NECESSITY
 SUMMARY: PRELIMINARY ESTIMATE

9 - AC-103 REPLACEMENT	QUANTITY		MATERIAL		LABOR		TOTAL COST
	NO. OF UNITS	UNIT OF MEASURE	PER UNIT	TOTAL	PER UNIT	TOTAL	

BASE BID COST ESTIMATE

DUCTWORK DEMOLITION	1.0	EA		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
RTU REMOVAL	1.0	EA		\$ -	\$ 1,500.00	\$ 1,500.00	\$ 1,500.00
PIPING DEMOLITION	1.0	EA		\$ -	\$ 1,000.00	\$ 1,000.00	\$ 1,000.00
ROOFTOP AHU UNIT (10,000 CFM)	1.0	EA	\$ 75,000.00	\$ 75,000.00	\$ 25,000.00	\$ 25,000.00	\$ 100,000.00
CHILLED WATER AND HEATING WATER PIPING, VALVES AND FITTINGS (ROOFTOP AHU)	1.0	EA	\$ 2,500.00	\$ 2,500.00	\$ 5,000.00	\$ 5,000.00	\$ 7,500.00
FREEZE PROTECTION PUMPS	1.0	EA	\$ 900.00	\$ 900.00	\$ 2,800.00	\$ 2,800.00	\$ 3,700.00
HEATING WATER PIPING, VALVES AND FITTINGS	1.0	EA	\$ 2,500.00	\$ 2,500.00	\$ 3,000.00	\$ 3,000.00	\$ 5,500.00
DUCTWORK	1.0	EA	\$ 10,000.00	\$ 10,000.00	\$ 10,000.00	\$ 10,000.00	\$ 20,000.00
DUCT DETECTORS	4.0	EA	\$ 300.00	\$ 1,200.00	\$ 500.00	\$ 2,000.00	\$ 3,200.00
AHU ATC CONTROLS	1.0	EA	\$ 10,000.00	\$ 10,000.00	\$ 14,000.00	\$ 14,000.00	\$ 24,000.00
PIPING INSULATION	1.0	EA	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
DUCT INSULATION	1.0	EA	\$ 2,000.00	\$ 2,000.00	\$ 3,000.00	\$ 3,000.00	\$ 5,000.00
CONDENSATE PIPING	1.0	EA	\$ 500.00	\$ 500.00	\$ 750.00	\$ 750.00	\$ 1,250.00
TESTING AND BALANCING	1.0	EA		\$ -	\$ 4,500.00	\$ 4,500.00	\$ 4,500.00
COMMISSIONING	1.0	EA		\$ -	\$ 3,000.00	\$ 3,000.00	\$ 3,000.00
ELECTRICAL DISCONNECTS	1.0	EA	\$ 1,000.00	\$ 1,000.00	\$ 500.00	\$ 500.00	\$ 1,500.00
MOTOR CONTROLLERS	1.0	EA	\$ 500.00	\$ 500.00	\$ 500.00	\$ 500.00	\$ 1,000.00
CONDUIT AND WIRE	1.0	EA	\$ 1,700.00	\$ 1,700.00	\$ 2,200.00	\$ 2,200.00	\$ 3,900.00
FIREALARM INTERFACE OF DUCT	4.0	EA	\$ 300.00	\$ 1,200.00	\$ 250.00	\$ 1,000.00	\$ 2,200.00

COST ESTIMATE SUMMARY

DESCRIPTION	MATERIAL	LABOR	TOTAL
BASE BID TOTAL COST	\$ 111,000.00	\$ 83,750.00	\$ 194,750.00
TOTAL BASE BID:	\$ 111,000.00	\$ 83,750.00	\$ 194,750.00
TOTAL BASE BID COST PER SQUARE FOOT:	\$22.20 PER S.F.	\$16.75 PER S.F.	\$38.95 PER S.F.

GRAND TOTAL COST ESTIMATE SUMMARY

ADDITIONAL PROJECT COST ITEM DESCRIPTION (APPLIES TO BASE BID ONLY)	PERCENTAGE (%)	% X TOTAL BASE BID	REMARKS
CONTRACTOR OVERHEAD	0.0%	\$ -	
CONTRACTOR PROFIT	0.0%	\$ -	
GENERAL CONDITIONS	0.0%	\$ -	
BUILDER'S RISK INSURANCE	0.0%	\$ -	
PERMIT FEES	0.0%	\$ -	
CONTRACTOR INSURANCE	0.0%	\$ -	
PAYMENT BOND	0.0%	\$ -	
PERFORMANCE BOND	0.0%	\$ -	
TOTAL ADDITIONAL PROJECT COST ITEMS		\$ -	
GRAND TOTAL CONSTRUCTION COST (BASE BID + ADDITIONAL PROJECT COSTS)		\$ 194,750.00	\$38.95 PER S.F.